



Type of construction:	Rigid:	Flexible:
Size of Yorkshire:	Length x width x 75mm (length (up to 1.2m) and width (up to 0.6m) as specified elsewhere)	Length x width x 75mm (length (up to 1.2m) and width (up to 0.6m) as specified elsewhere)
Joint width:	8mm	3mm
Joint material:	Jointing Mortar BS7533-7: 2010 5.2.2 and Table C.5	Silica sand to BS 7533-7 Annex C, C.1.3
Joint sealer:	Not applicable	Clear liquid resin
Laying Course:	Modified Fine Concrete - Type B Mortar BS7533 -7 :2010 5.1.2.2.1 and Table C.4 Moist mix	Sands to BS7533-7 Annex C C.1.2
Concrete base:	Concrete Class ST4 Contraction joint / crack inducer required at 10m centres. Expansion required at 30m centres. Concrete base must achieve 15N/mm ² prior to placing laying course and setts	None
Sub-base:	Sub-base Type 1 to Clause 803 Or Use existing footway foundation if present and suitable	Sub-base Type 1 to Clause 803

Rigid Construction

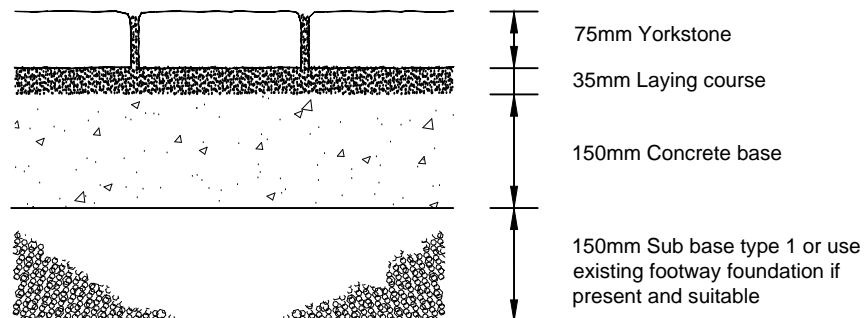

Flexible Construction

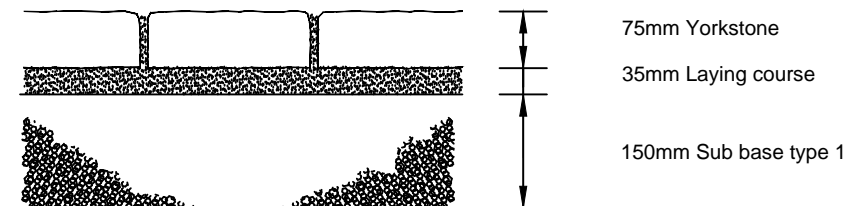

Drawing Title:

Standard Detail Yorkstone Paving Flags and Setts Concrete Block and Clay Paving (Flexible)

Version	Amendment	Date
Checked By: M. Batham	Drawing Number: SD-1100-15	Version: -
Date Issued: Oct 16		