


End chamber detail.

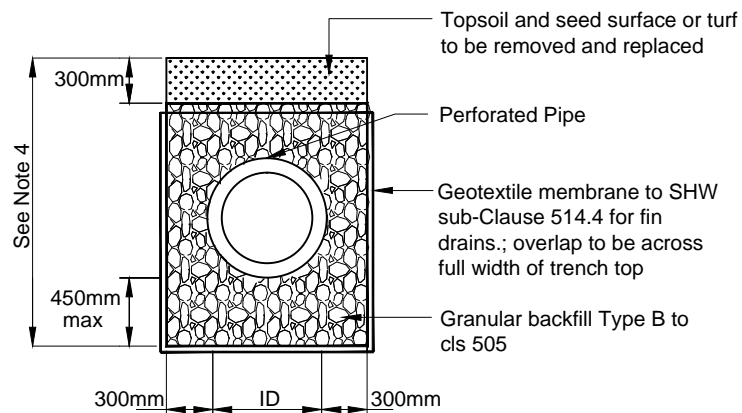

Typical Section through soakaway.

Notes:

1. Construction details to be as per HCD F11.
2. Chamber diameter and depth and Incoming pipe diameter and depth to be in accordance with the Contract Drawings and Appendices.
3. Large ring heights to be used to reduce loss of integrity of ring when severed to construct chamber with larger diameter pipes.
4. A site specific structural design is required for all pipes greater than 900mm dia. This will be provided to the contractor by the Service Manager.
5. All dimensions are in millimetres.

Pipe dia.	Chamber dia.	Granular backfill		
600	1500	300	600	900
750	1800	300	600	900
900	1800	300	600	900
1200	3000	300	600	900
1500	3000	300	600	900

Included in standard item coverage

See Note 4.



Standard Detail Horizontal Soakaway

Version	Amendment	Date
Checked By: B. Bartlett	Drawing Number: SD-500-10	Version: -
Date Issued: Oct 16		